



BEARING CAPACITY
MIN. 2000 psf (SLS)

4" PERFORATED DRAIN TILE
AS REQUIRED ON SITE AND
PER GEOTECHNICAL

3 SECTION
S2 SCALE: 3/4" = 1'-0"

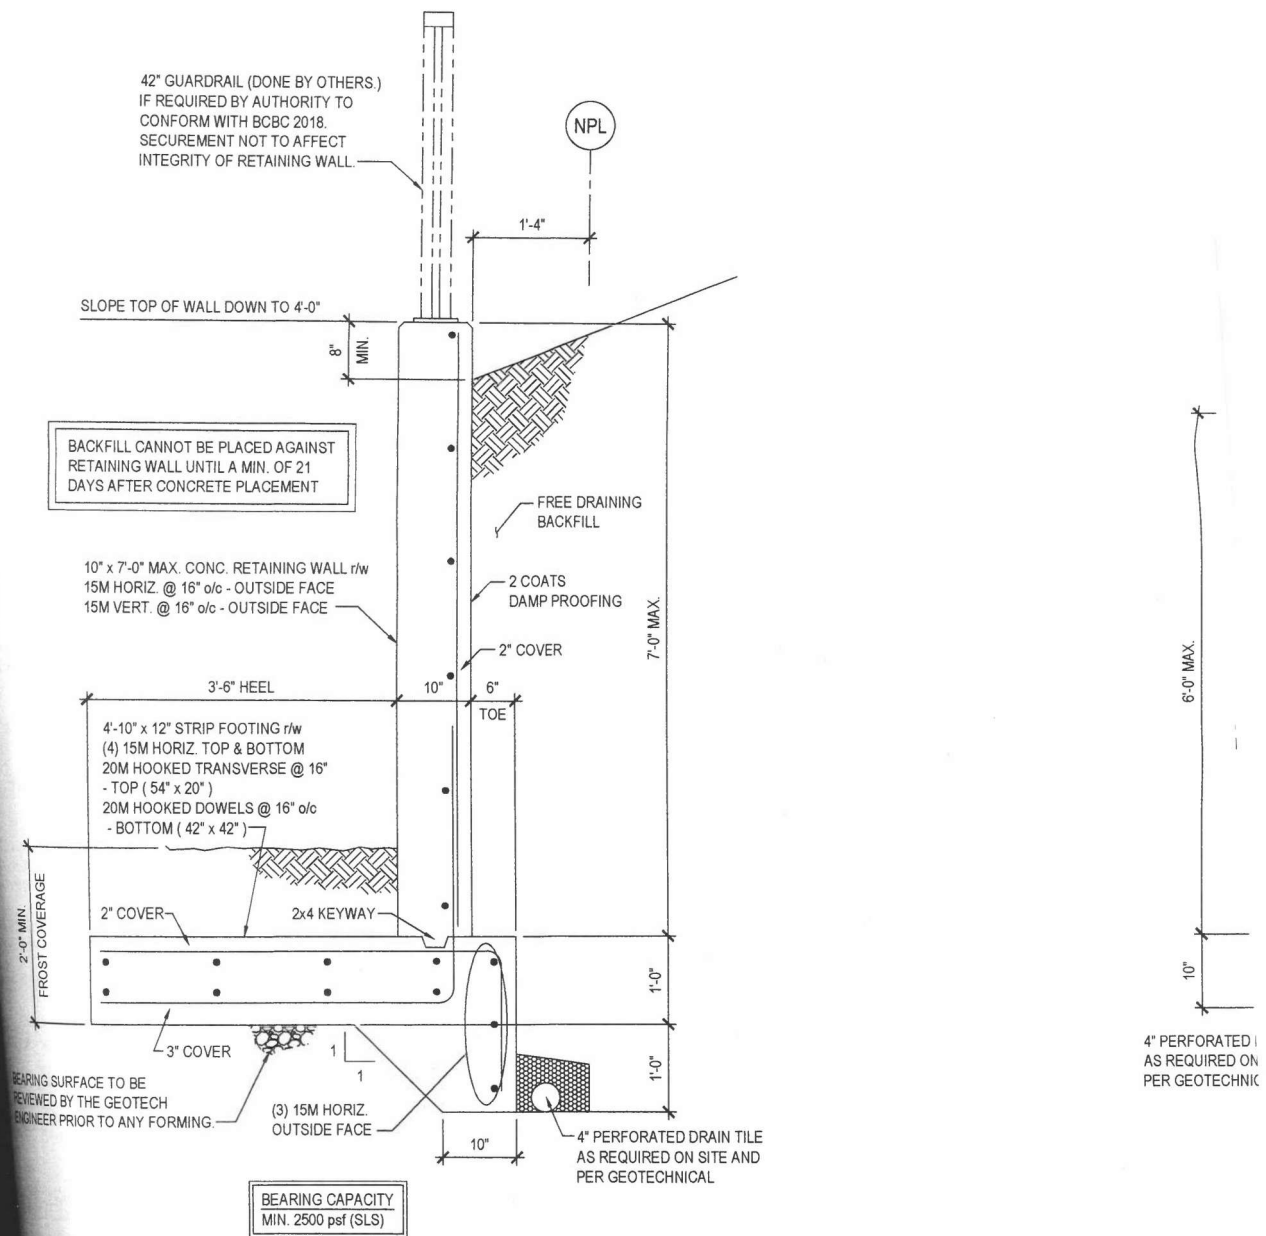

2 SECTION

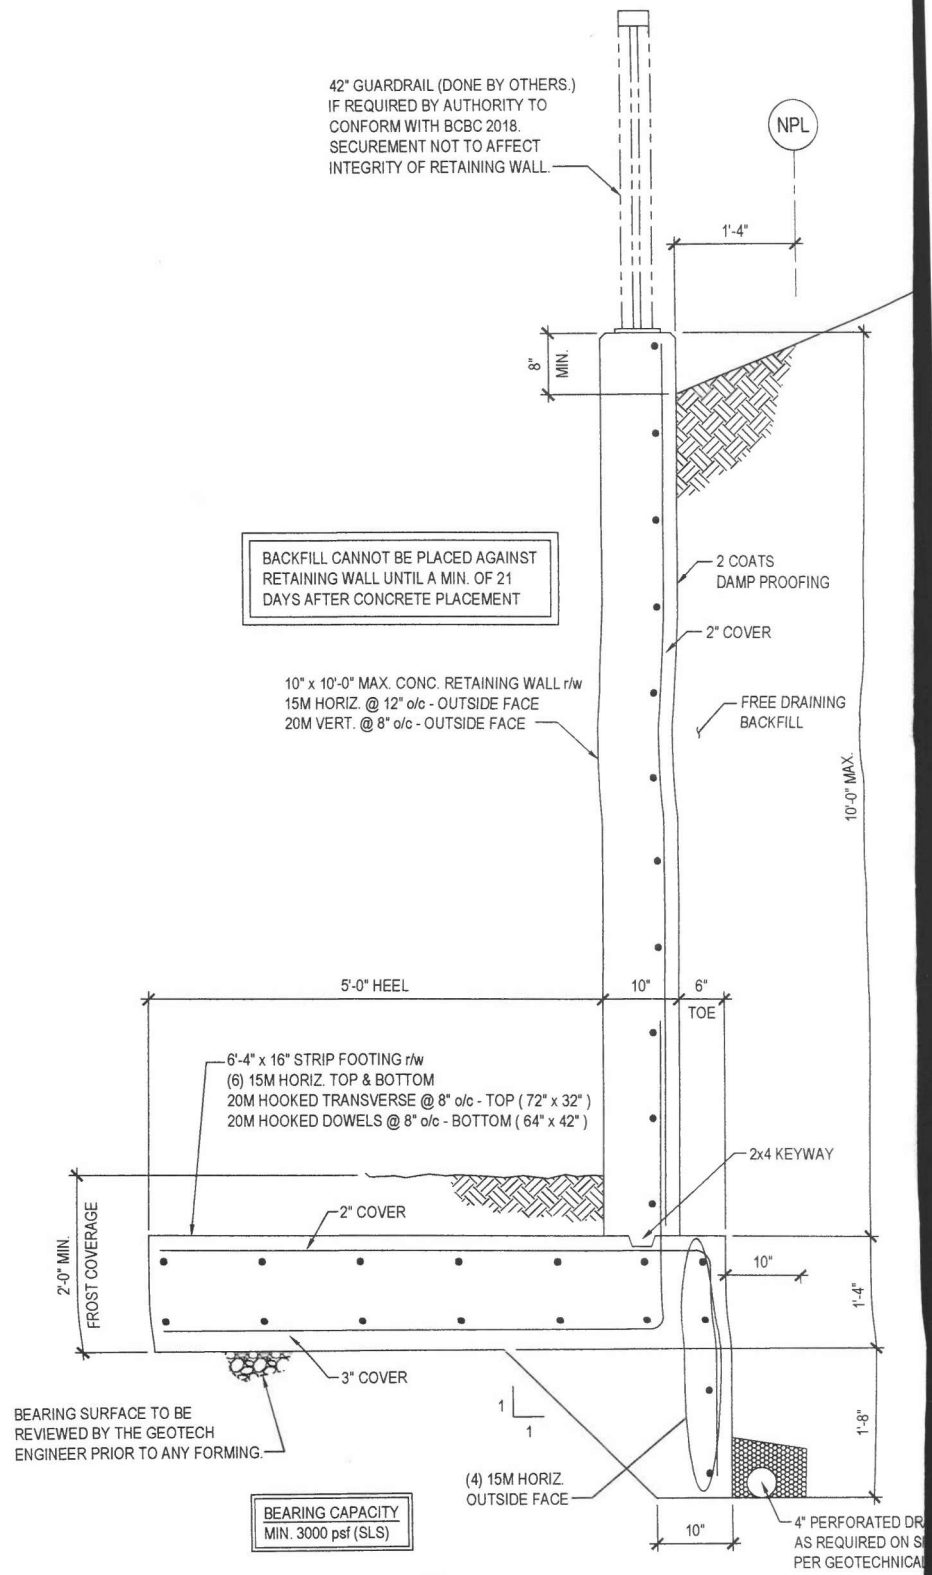

42" GUARDRAIL (DONE BY OTHERS.)
 IF REQUIRED BY AUTHORITY TO
 CONFORM WITH BCBC 2018.
 SECUREMENT NOT TO AFFECT
 INTEGRITY OF RETAINING WALL.

NPL

BACKFILL CANNOT BE PLACED AGAINST
 RETAINING WALL UNTIL A MIN. OF 21
 DAYS AFTER CONCRETE PLACEMENT

10" x 10'-0" MAX. CONC. RETAINING WALL r/w
 15M HORIZ. @ 12" o/c - OUTSIDE FACE
 20M VERT. @ 8" o/c - OUTSIDE FACE

6'-4" x 16" STRIP FOOTING r/w
 (6) 15M HORIZ. TOP & BOTTOM
 20M HOOKED TRANSVERSE @ 8" o/c - TOP (72" x 32")
 20M HOOKED DOWELS @ 8" o/c - BOTTOM (64" x 42")

BEARING CAPACITY
 MIN. 3000 psf (SLS)

1 SECTION
S2 SCALE: 3/4" = 1'-0"

BEARING SURFACE TO BE
 REVIEWED BY THE GEOTECH
 ENGINEER PRIOR TO ANY FORMING.

4" PERFORATED DR
 AS REQUIRED ON S
 PER GEOTECHNICAL